


Figure 8

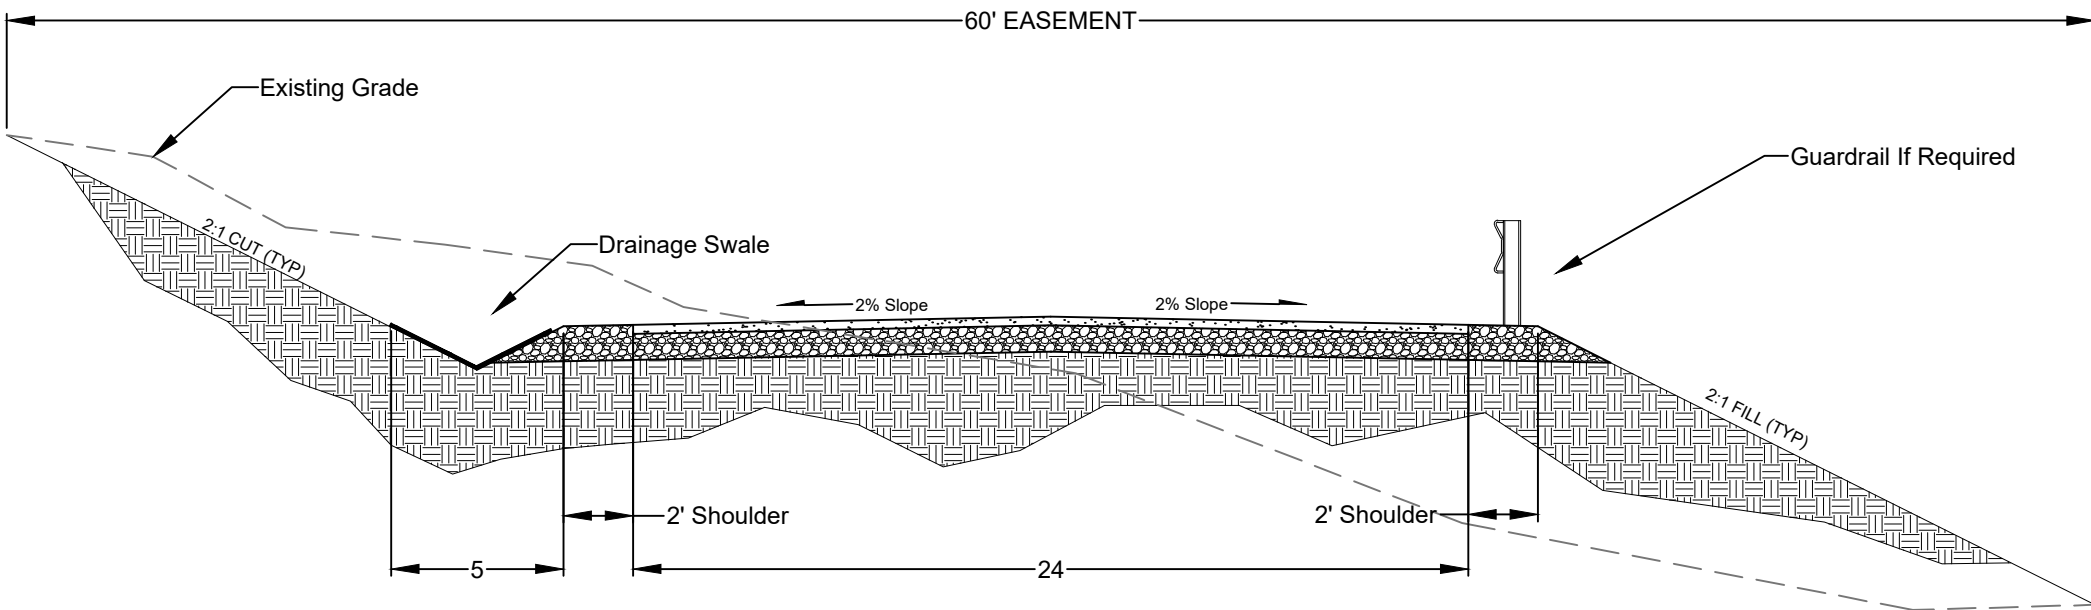

NOTES:

1. SUB GRADE PREPARATION AND ROAD SECTION TO BE PER 14.02.07 L.
2. ROAD TO HAVE A MINIMUM OF THREE INCHES (3") OF ASPHALT OVER EIGHT INCHES (8") OF ROAD BASE.
3. SHOULDER WILL BE CONSTRUCTED WITH EIGHT INCHES (8") OF COMPACTED ROAD BASE.
4. PERMANENT EROSION CONTROL MAT* OR A MINIMUM OF SIX INCHES (6") OF RIP RAP REQUIRED FOR DRAINAGE SWALE SLOPES GREATER THAN 5 PERCENT.
5. CHECK DAMS, SPACED NO FURTHER THAN EVERY TWO HUNDRED FEET (200'), REQUIRED FOR DRAINAGE SWALE SLOPES GREATER THAN 5 PERCENT.
6. CUT OR FILL SLOPES STEEPER THAN 3:1 TO BE DESIGNED AND APPROVED BY A GEOTECHNICAL ENGINEER.
7. GUARDRAIL REQUIRED ON ALL FILL SLOPES STEEPER THAN 3:1 WHERE THE VERTICAL DROP OF THE SLOPE IS GREATER THAN EIGHT FEET (8').
8. ALL DISTURBED SURFACES SHALL BE COVERED WITH SIX INCHES (6") OF TOPSOIL AND SEEDED.

* PERMANENT EROSION CONTROL MAT TO CONFORM TO THE FOLLOWING MINIMUM SPECIFICATIONS:

- | | |
|--------------------------------------|-----------------|
| • THICKNESS | 0.4 IN |
| • GROUND COVER FACTOR | 74% |
| • TENSILE STRENGTH | 170 X 125 LB/FT |
| • TENSILE ELONGATION | 50% MAX |
| • ULTRAVIOLET STABILIZATION 1000 HRS | 80% |