


60' Major Local

Figure 4

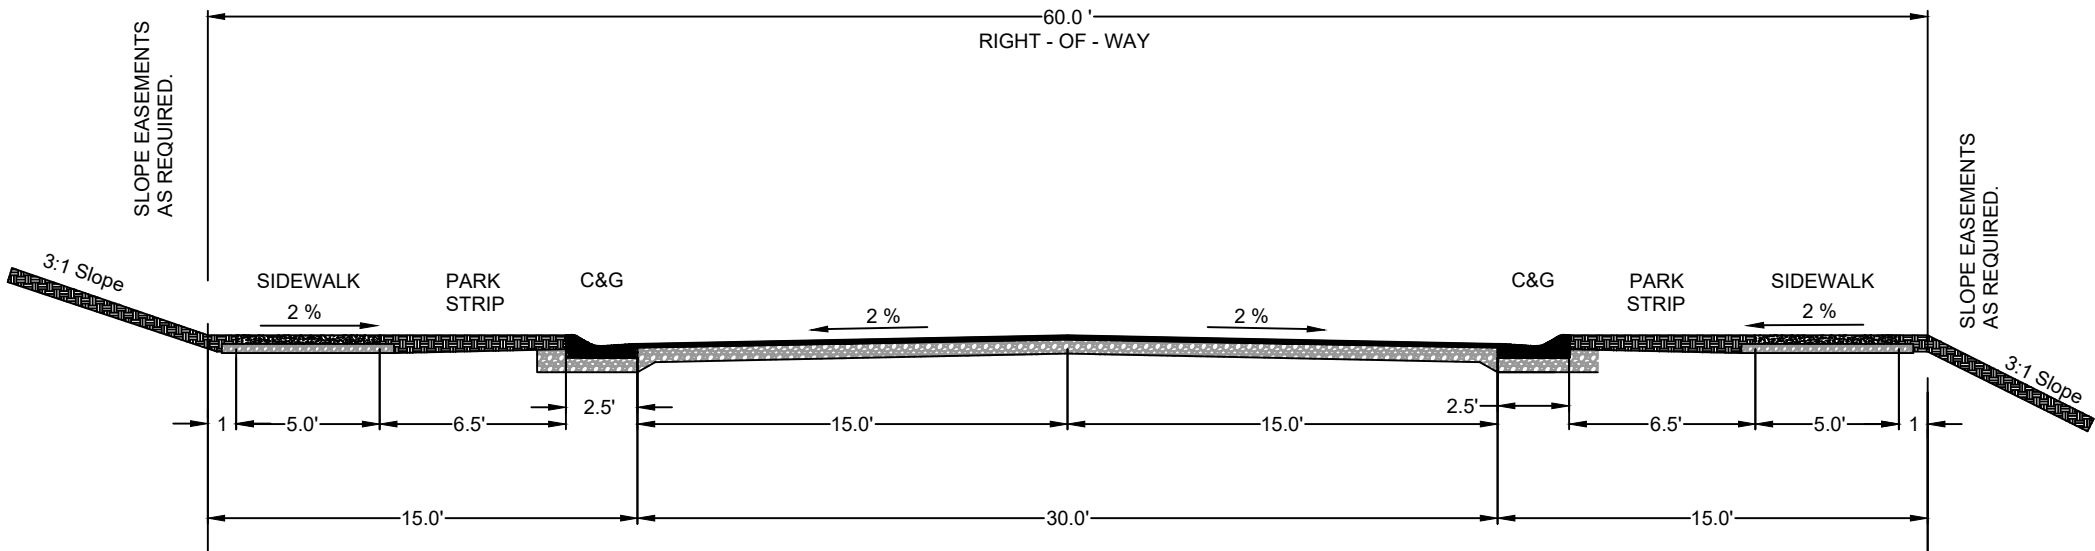

NOTES:

1. SUB GRADE PREPARATION AND ROAD SECTION TO BE PER 14.02.07 L.
2. THE SIDEWALK WILL HAVE FIVE INCHES (5") OF CONCRETE OVER SIX INCHES (6") OF ROAD BASE.
3. ALL DISTURBED SURFACES SHALL BE COVERED WITH SIX INCHES (6") OF TOPSOIL AND SEEDED.
4. ROAD WILL HAVE A MINIMUM OF THREE INCHES (3") OF ASPHALT OVER EIGHT INCHES (8") OF ROAD BASE.
5. CUT OR FILL SLOPES STEEPER THAN 3:1 TO BE DESIGNED AND APPROVED BY A GEOTECHNICAL ENGINEER.
6. GUARDRAIL REQUIRED ON ALL FILL SLOPES STEEPER THAN 3:1 WHERE THE VERTICAL DROP OF THE SLOPE IS GREATER THAN EIGHT FEET (8').